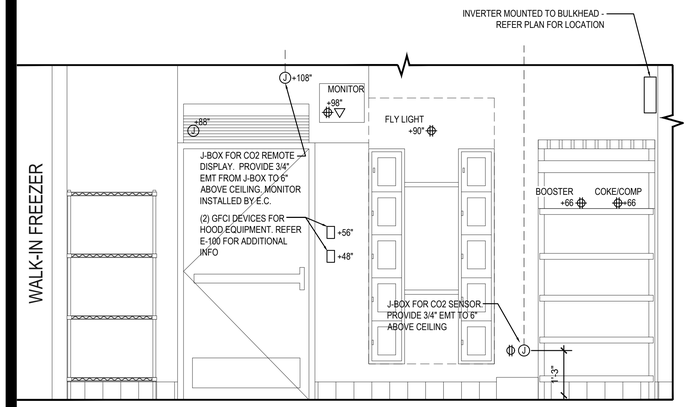

BOH REAR WALL ELEVATION 9

NOT TO SCALE E-200

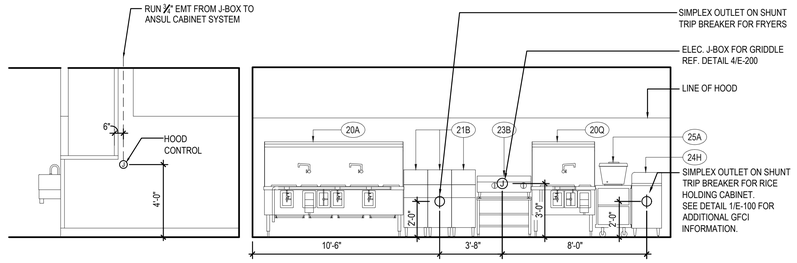

COOKLINE ELECTRICAL ELEVATIONS 6

NOT TO SCALE E-200

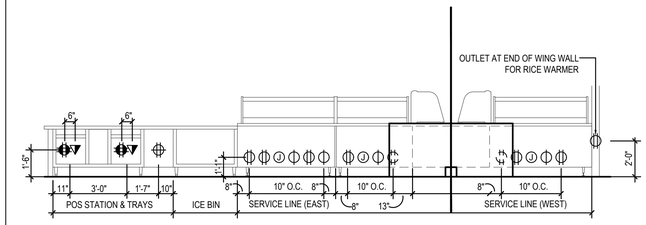

P.O.S. & SERVICE LINE ELEVATION 3

NOT TO SCALE E-200

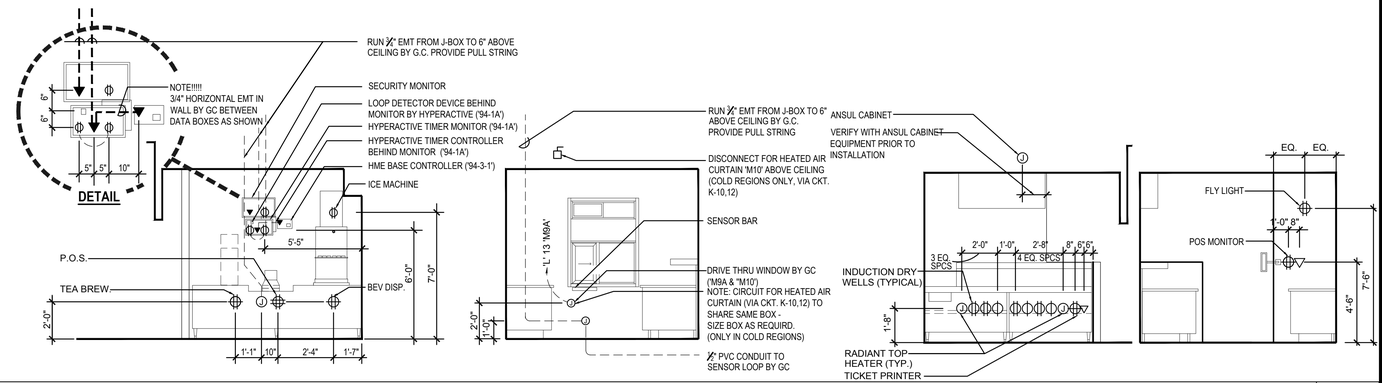

DRIVE-THRU ELEVATIONS 2

Scale: approx. 1/4"=1'-0" E-200

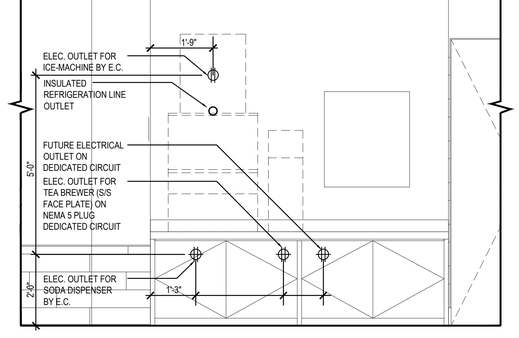

DRINK STATION ELEVATION 5

NOT TO SCALE E-200

NOT USED 8

NOT TO SCALE E-200

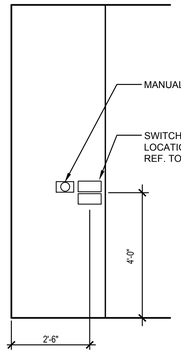

SWITCH BANK ELEV 7

NOT TO SCALE E-200

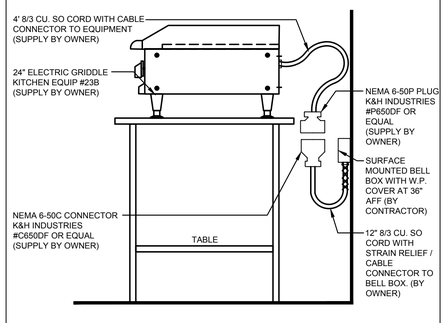

CIRCUIT GRIDDLE TO 40/3 CIRCUIT BREAKER WITH 120VAC SHUNT TRIP. SHUNT TRIP CONTROL FROM HOOD ANSUL SYSTEM. FEED WITH 3 #8, #10 GROUND, 1" CONDUIT.

GRIDDLE 23B (EG-24H) 4

NOT TO SCALE E-200

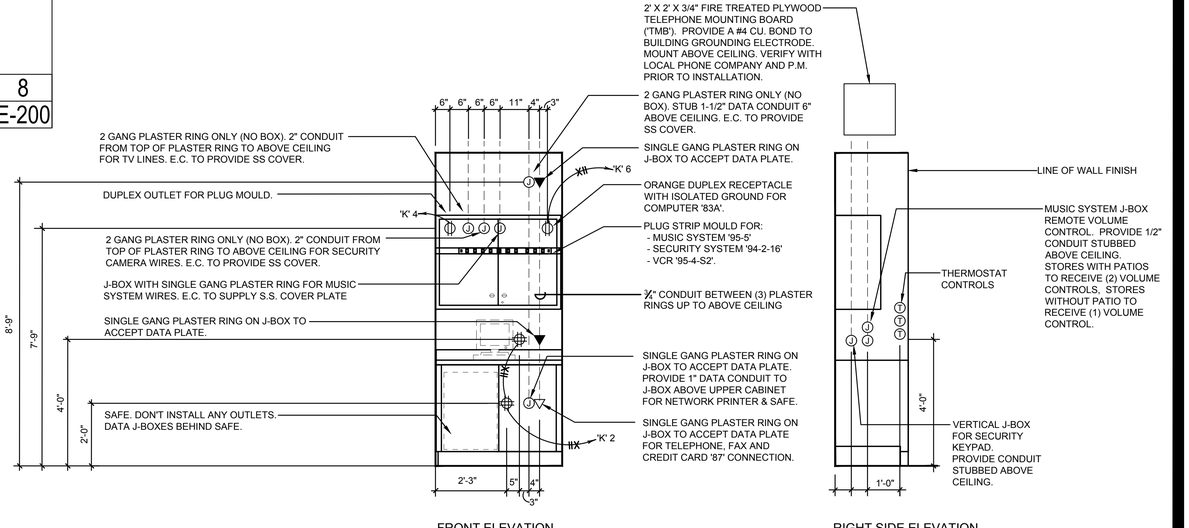

MANAGER'S STATION ELEVATIONS 1

NOT TO SCALE E-200

PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1st	DEVELOPER REVIEW	07.15.19
2nd	SITE PLAN SUBMITTAL	08.26.19
3rd	SITE COMMENTS	09.05.19
4th	ISSUE FOR PERMIT	10.01.19
5th	ISSUE FOR BID	11.07.19

DRAWN BY: PM / KL / EA

PANDA PROJECT #: S8-20-D7163

ARCH PROJECT #: 19027

James F. Turner Engineers, L.P.
Consulting Engineers
8340 Meadow Road, #160
Dallas, TX 75231
214.750.2900
DRAWN/DESIGN: JBJ
QC/APPD: TNM
Job #: 4Z736
CoA #: CA-5874-E

ALABAMA REGISTERED No. 14970 PROFESSIONAL ENGINEER JAMES F. TURNER
11/1/19

Heights Venture
ARCHITECTURE DESIGN

HOUSTON
1111 North Loop West, Suite 800
Houston, Texas 77008
713 869 1103 V

DALLAS
5741 Legacy Drive, Suite 320
Plano, Texas. 75024
972 490 7292 V

PANDA EXPRESS

2096 INTERSTATE DR.
OPELIKA, AL, 36801

3600 FSDT

TWW REMODEL

E-200

ELECTRICAL ELEVATIONS

BID ISSUE

TRUE WARM & WELCOME